



RIGHT-SIDE VIEW

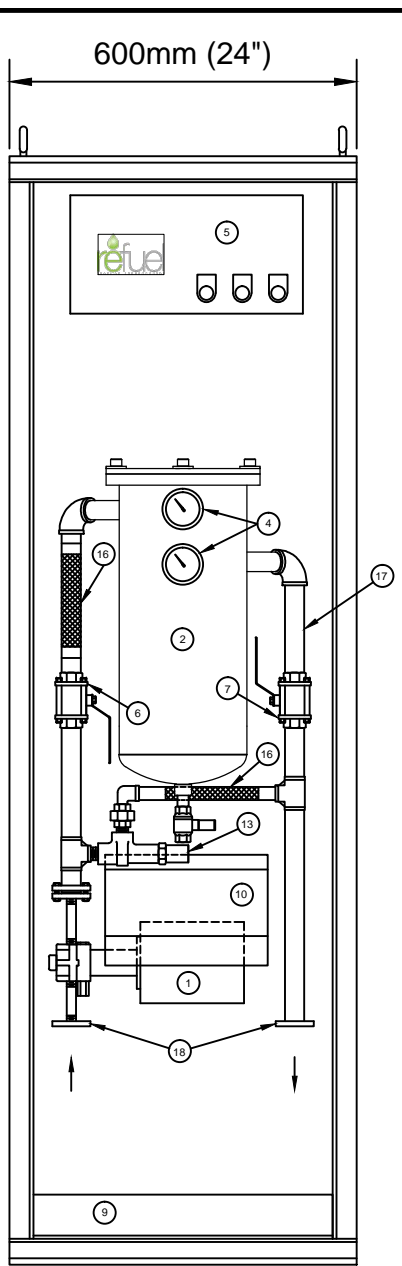

FRONT VIEW

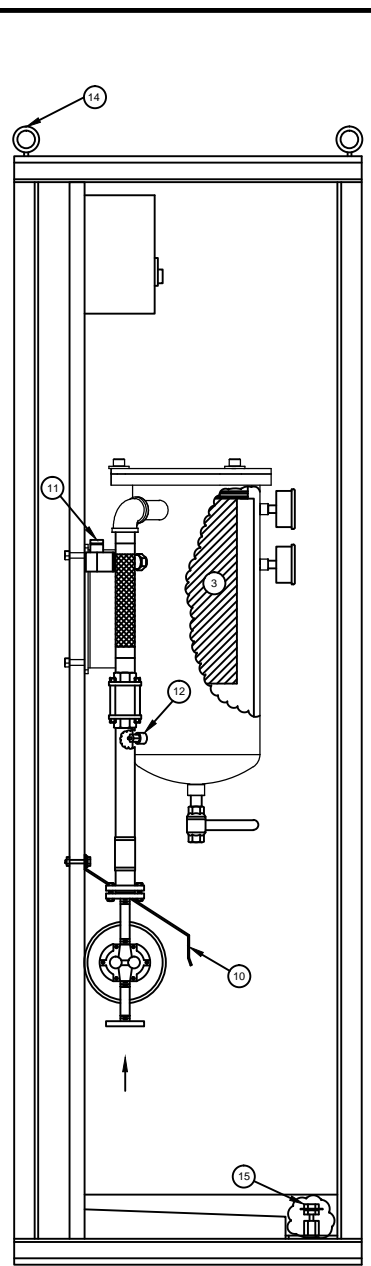

LEFT-SIDE VIEW

NO.	DESCRIPTION
1	8.2gpm PUMP (120V SINGLE PH)
2	STAINLESS STEEL FILTER CANISTER
3	INTEGRITY ULSD/BIO FILTER
4	LIQUID FILLED PRESSURE GAUGES
5	CONTROL PANEL (C.S.A. APPROVED)
6	INLET ISOLATION VALVE - 25mm (1")
7	OUTLET ISOLATION VALVE - 25mm (1")
8	WATER DRAIN VALVE - 12.5mm (1/2")
9	STAINLESS STEEL DRIP TRAY
10	STAINLESS STEEL SPLASH SHIELD
11	PRESSURE TRANSMITTER
12	WATER SENSOR
13	PRESSURE RELIEF VALVE - 12.5mm (1/2")
14	LIFT POINTS
15	FLOAT SWITCH
16	STAINLESS STEEL BRAIDED FLEXLINE
17	STAINLESS STEEL WELDED PIPING - 25mm (1")
18	STAINLESS STEEL FLANGE

INSTALLATION NOTES:
 A. 120V SINGLE PHASE DEDICATED CIRCUIT.
 B. EXTERNAL PIPE TO BE MECHANICALLY PROTECTED.
 C. USE MINIMUM NUMBER OF JOINTS POSSIBLE.
 D. SYSTEM TO BE INSTALLED WITH ADDITIONAL ISOLATION VALVES TO AND FROM THE TANK.

10 Morris Dr. Suite 18 Dartmouth, Nova Scotia B3B 1K8
Ph: 902.880.8010 Fx. 902.468.3289

PROJECT TITLE:	DATE: NOV 29, 2011
DRAWN BY: ROBBIE ROBERTSON	DWG. NO.: RSI - IN10